





ANNEX G1 LANDFILL GAS MONITORING
LOCATIONS FOR SERVICE VOIDS,
UTILITIES AND MANHOLES ALONG THE
SITE BOUNDARY AND WITHIN THE
SENTX SITE

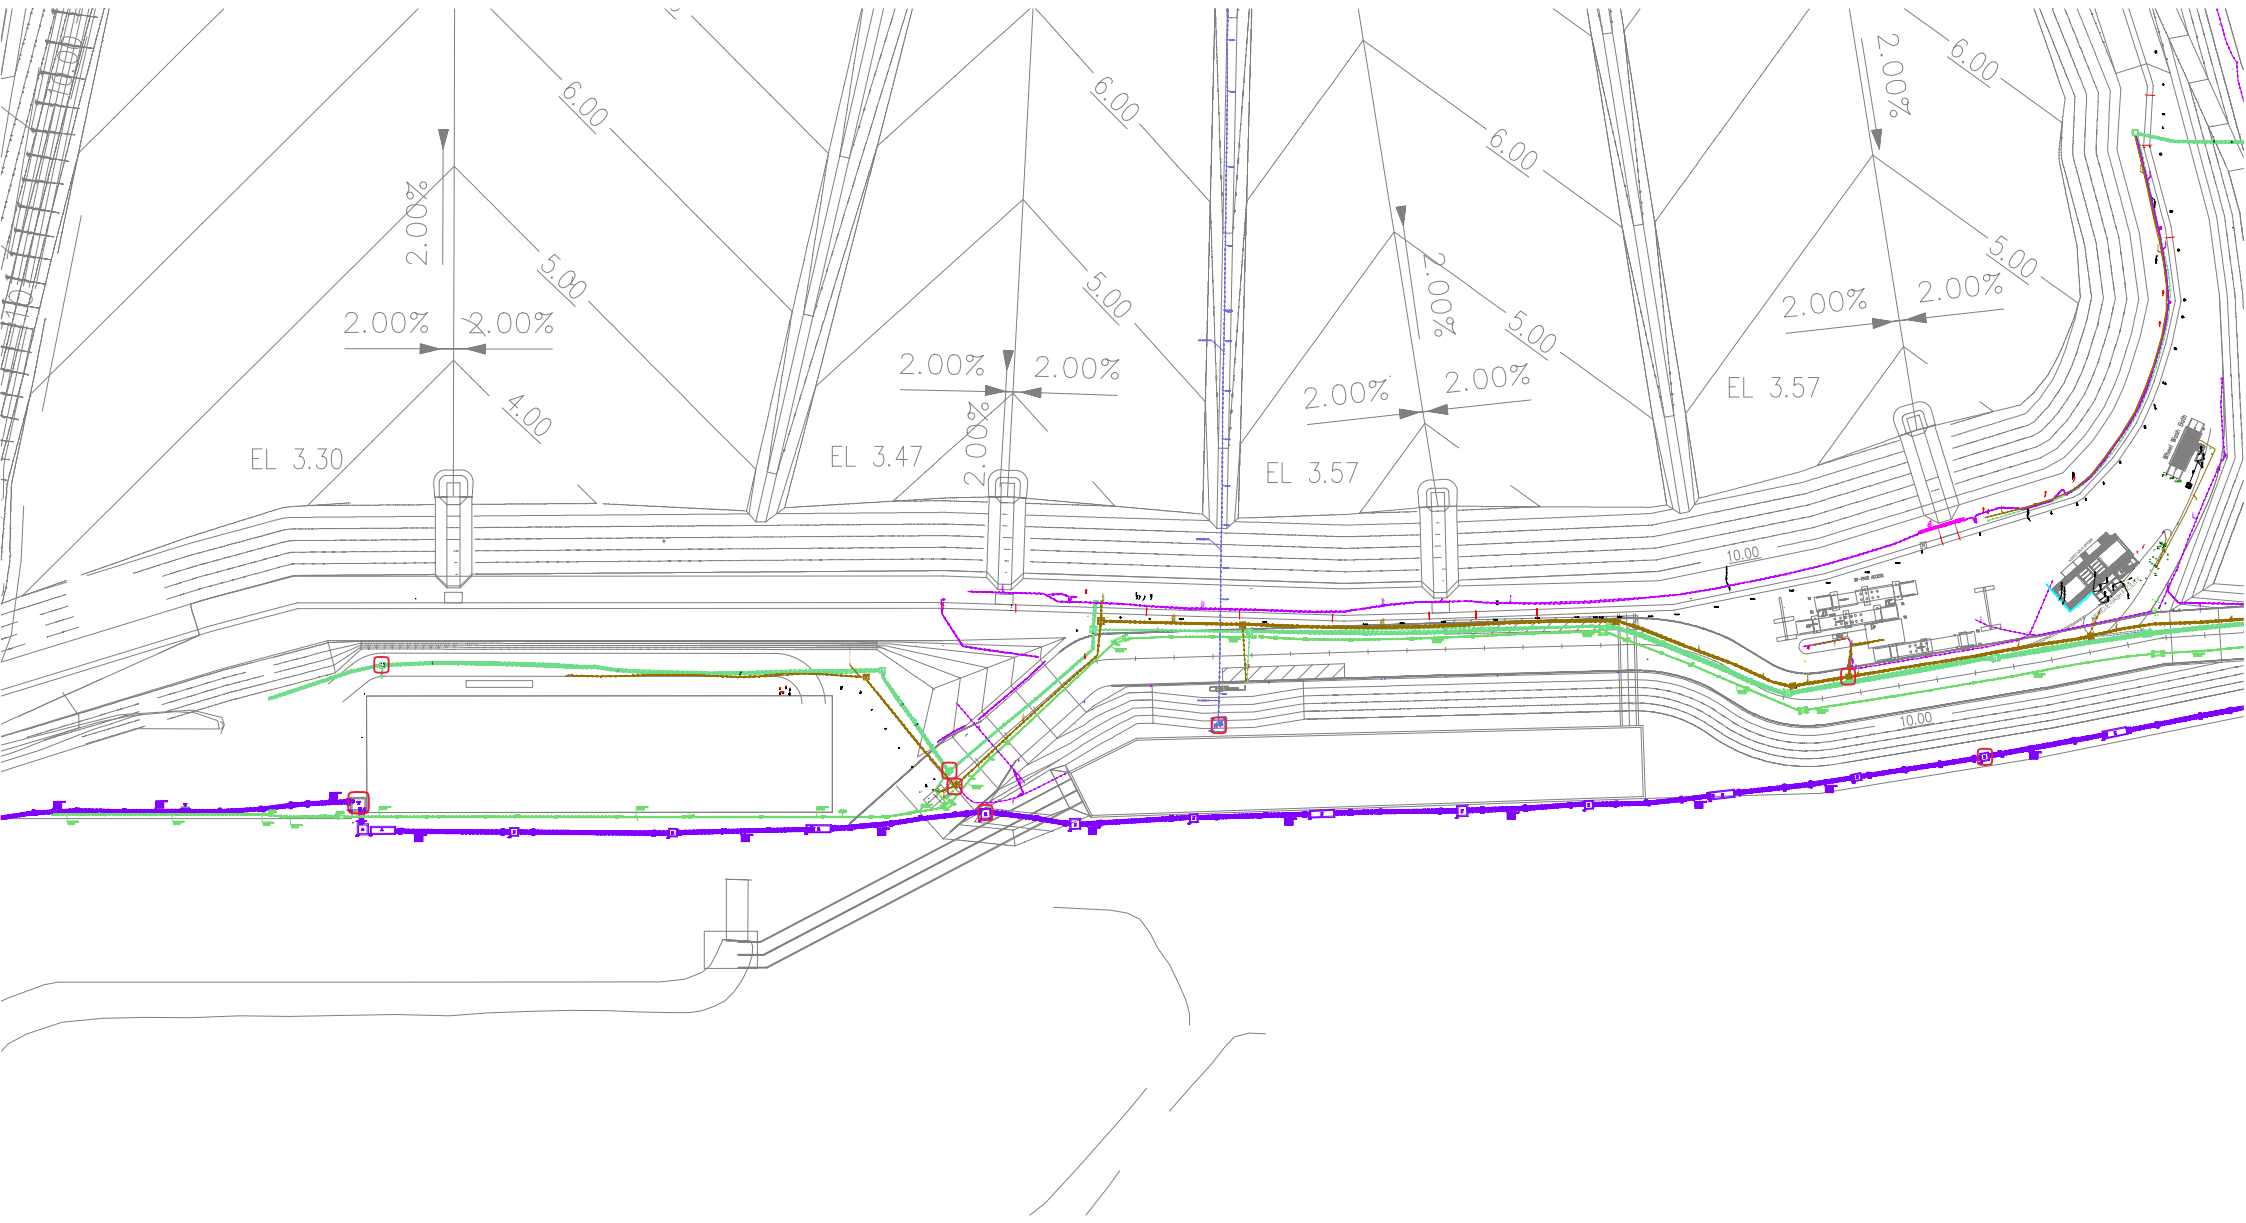

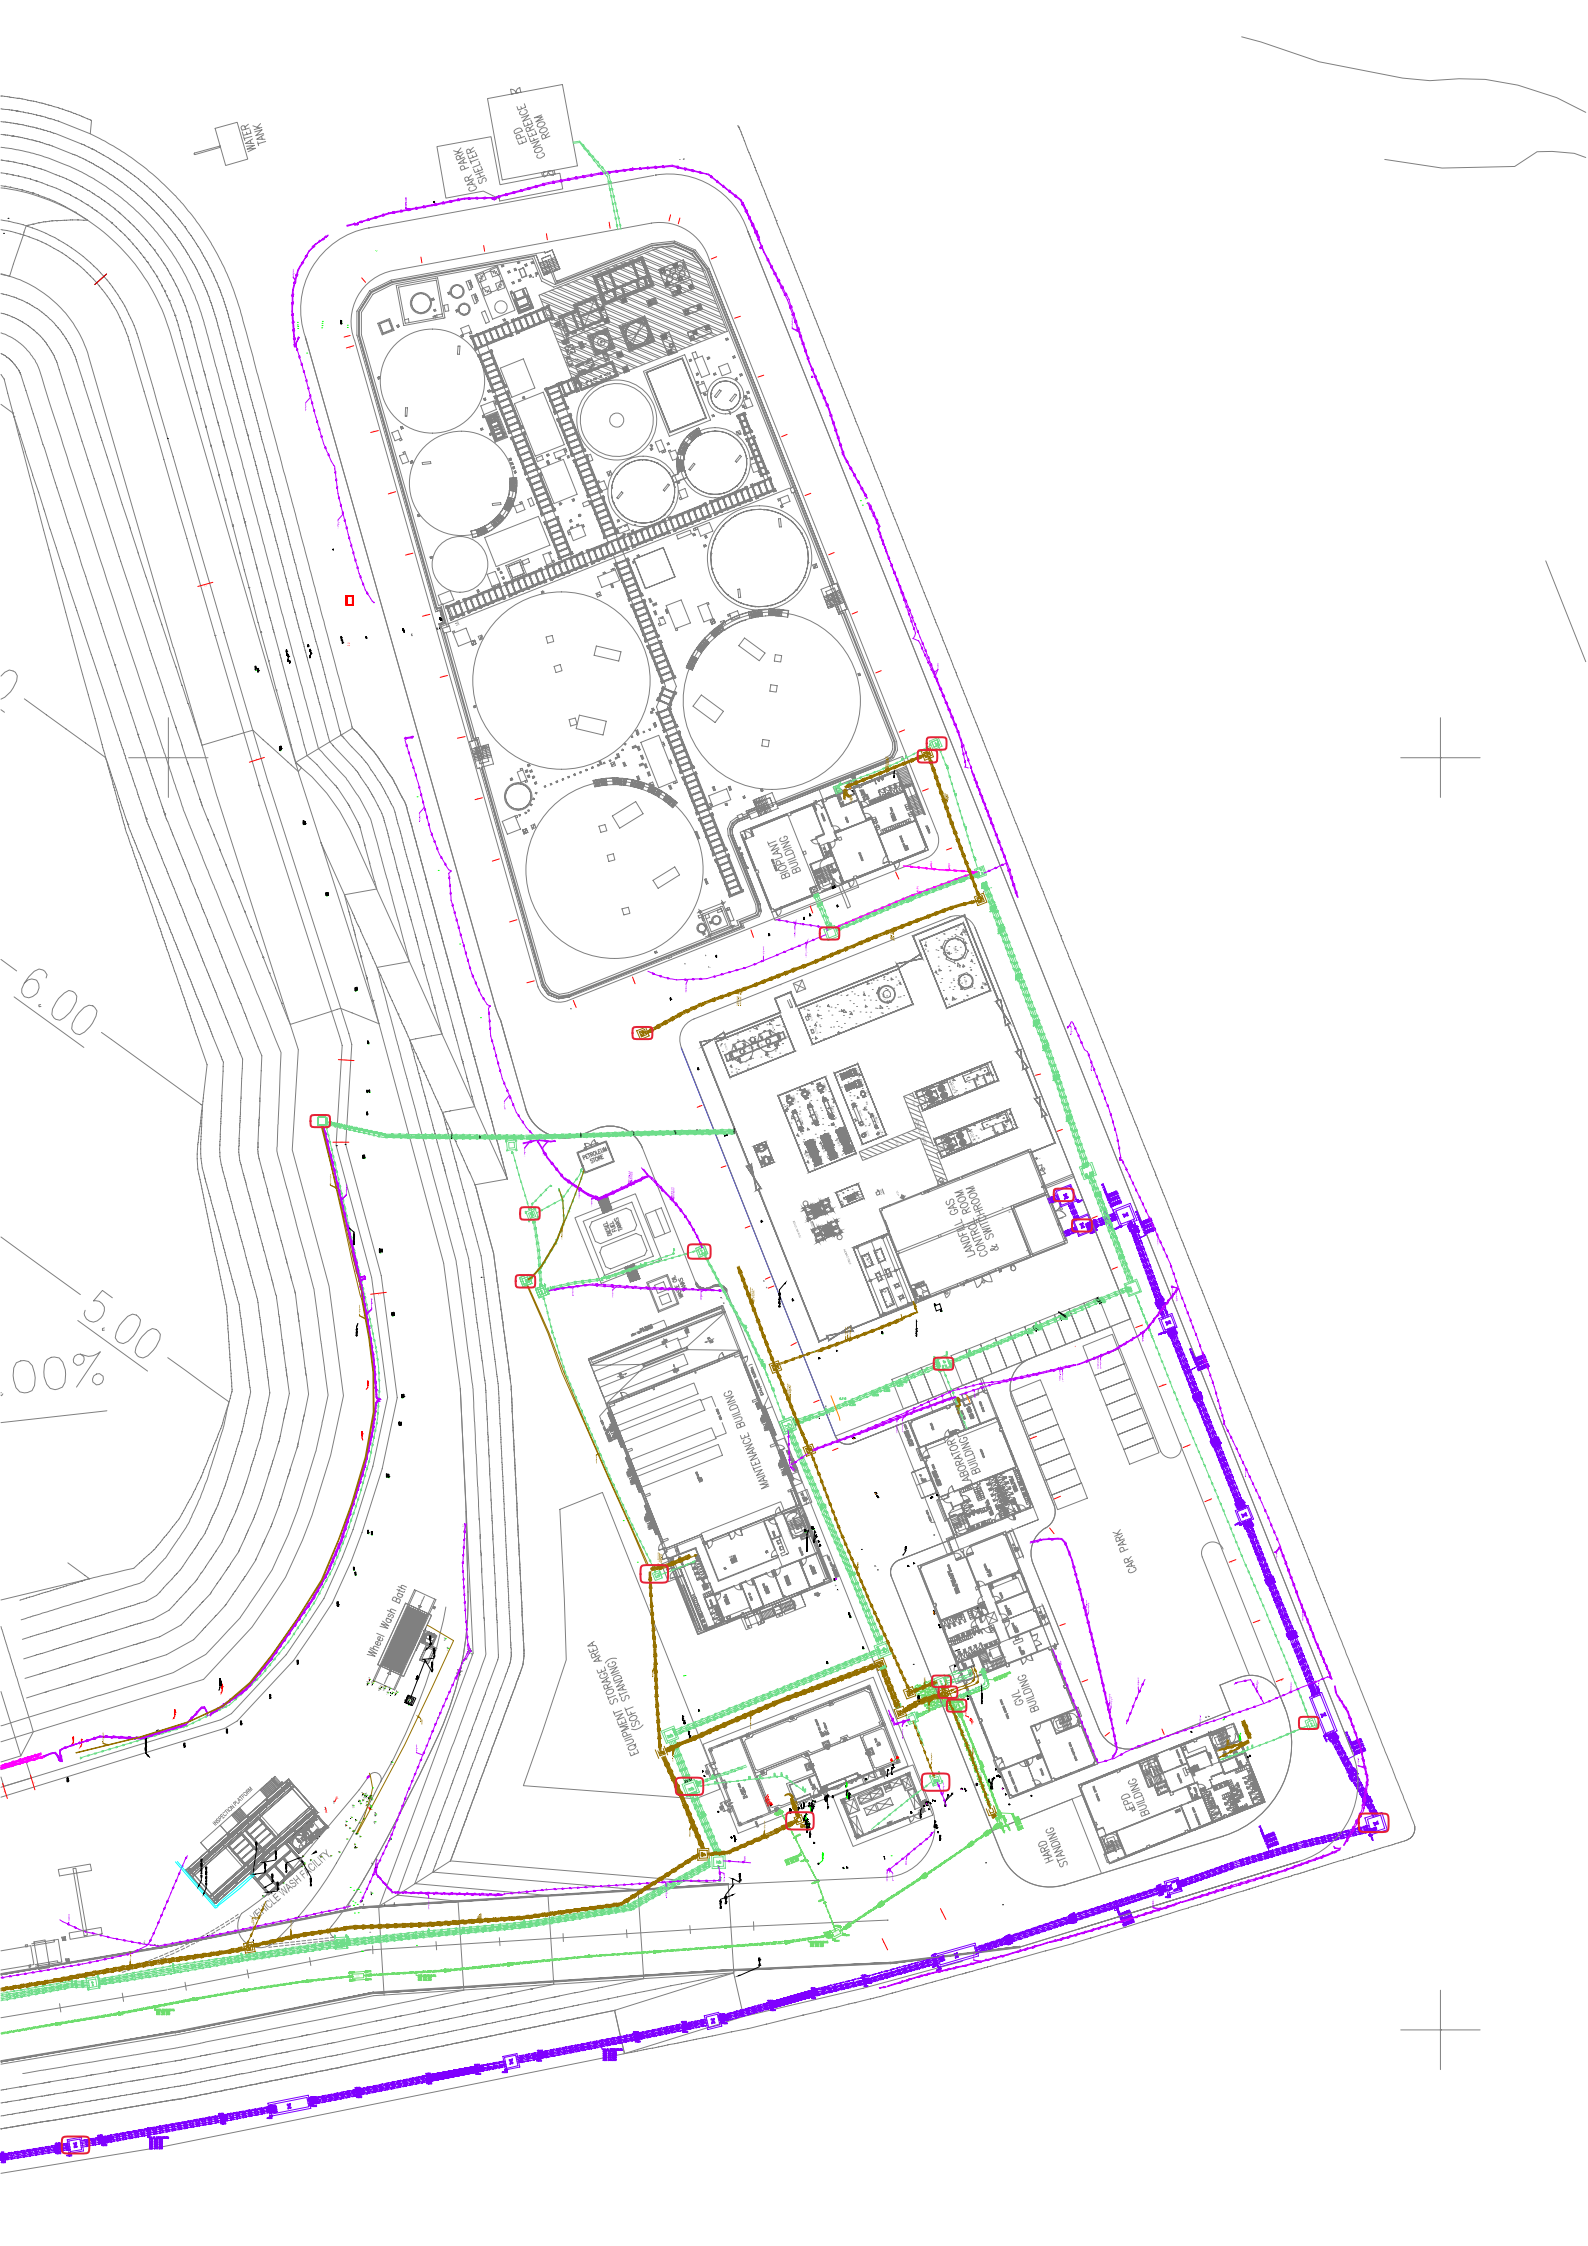

WATER TANK

CAR PARK

CONTROL ROOM

WATER TREATMENT BUILDING

WASTEWATER BUILDING

AS PLANT CONTROL ROOM

AS PLANT BUILDING

CAR PARK

WATER STORAGE TANKS

AS PLANT CONTROL ROOM

AS PLANT BUILDING

WASH BATH

6.00

5.00

0.00%